

Estimating PV System Size and Cost



RENEWABLE ENERGY
THE INFINITE POWER
OF TEXAS

SECO FACT SHEET **NO. 24**

HIGHLIGHTS

- ◆ **Off-grid photovoltaic (PV) systems can be affordable.**
- ◆ **Estimating the size and cost of a PV system to meet your needs is easy.**

INTRODUCTION

Photovoltaic (PV) energy generating systems (or PV systems) convert the sun's energy directly into electricity using state-of-the-art semiconductor materials. PV systems vary in complexity. Some are called "stand-alone" or "off-grid" systems, which means they are the sole source of power to a home, water pump or other load. Stand-alone systems can be designed to run with or without battery backup. Remote water pumps are often designed to run without battery backup, since water pumped out of the ground during daylight hours can be stored in a holding tank for use any time. In contrast, stand-alone home power systems often store energy generated during the day in a battery bank for use at night. Stand-alone systems are often cost-effective when compared to alternatives such as utility line extensions.

Other PV systems are called "grid-connected" systems. These work to supplement existing electric service from a utility company. When the amount of energy generated by a grid-connected

Appliance	AC or DC Watts		Hours Used/Day		Watt Hours/Day
Ceiling Fan	100	x	8.0	=	800
Coffee Maker	600	x	0.3	=	180
Clothes Dryer	4,856	x	0.8	=	3,885
Computer	75	x	2.0	=	150
Computer Monitor	150	x	2.0	=	300
Dishwasher	1,200	x	0.5	=	600
Lights, 4 Compact Fluorescents	4x15	x	5.0	=	300
Microwave Oven	1,300	x	0.5	=	650
Radio	80	x	4.0	=	320
Refrigerator	600	x	9.0	=	5,400
Television	300	x	8.0	=	2,400
Vacuum Cleaner	600	x	0.2	=	120
VCR	25	x	8.0	=	200
Washing Machine	375	x	0.5	=	188
Total					15,493

Table 1 Typical household electrical appliances and run times

PV system exceeds the customer's loads, excess energy is exported to the utility, turning the customer's electric meter backward. Conversely, the customer can draw needed power from the utility when energy from the PV system is insufficient to power the building's loads. Under this arrangement, the customer's monthly electric utility bill reflects only the net amount of energy received from the electric utility.

Each type of system requires specific components besides the PV modules. Generating AC power requires a device called an inverter. Battery storage requires special batteries and a battery charge controller. The final cost of any

PV system ultimately depends on the PV array size, the battery bank size, and on the other components required for the specific application.

This fact sheet is designed to generate an estimate for the PV array size, battery bank size, and total cost of a stand-alone PV system. (It can be used for grid-connected systems, too, but with several caveats that are identified in the step-by-step instructions.) This will help you converse knowledgeably with a professional PV designer or installer should you decide to purchase a system. To obtain a more complete system design that takes into consideration your particular power needs, site loca-



RENEWABLE ENERGY
THE INFINITE POWER
OF TEXAS

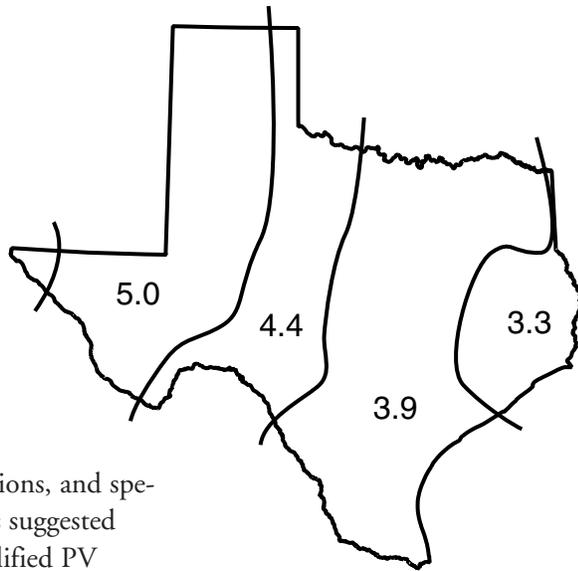


Figure 1 Solar Insolation Map for Texas *This shows the average number of hours of useful sunlight available in December for a PV module at latitude tilt.*

tion, local weather conditions, and specific equipment used, it is suggested that you work with a qualified PV designer or installer.

ESTIMATING PV SYSTEM SIZE AND COST

The worksheet presented here will help you estimate the size and cost of a PV system. The worksheet is adapted from a method developed by Sandia National Laboratories, and the analysis is conducted in two sections. In the first section, we derive the system specifications by determining the load, available sunlight, and the size of the PV array and battery bank needed. In the second section, we convert the system specification into a cost for the PV system. Let's walk through the analysis, step by step.

STEP 1. DETERMINE LOAD, AVAILABLE SUNLIGHT, PV ARRAY SIZE, AND BATTERY BANK SIZE

1.a. Determine Load. The preferred method for determining PV system loads is a “bottom-up” approach in which every daily load is anticipated and summed to yield an average daily total. For PV systems designed to power simple loads, such as a single water pump, electric light or other appliance, this method is easy. Simply look at the nameplate power rating on the appliance to calculate its power consumption in watts (some labels show amperage

and voltage only; to obtain watts, just multiply amps by the voltage). Then multiply by the number of hours it is expected to operate on an average day to obtain watt-hours (Wh).

For more complex loads, such as powering a whole house, you will need to estimate all the different loads in the house on a typical day and sum them. Table 1 provides an example calculation for a household using this method.

For complex loads like households, it is sometimes difficult to anticipate every electric load. Electric clocks, TVs, stereos and other appliances sometimes draw small amounts of power even when they are turned off. For this reason, we recommend multiplying your estimated daily load by a “fudge factor” of 1.5. Some other elements accounted for by this factor are all the system efficiencies, including wiring and interconnection losses, as well as the efficiency of the battery charging and discharging cycles.

Of course, for grid-connected systems, you can simply review your monthly utility bills to get an accurate idea of monthly energy consumption.

1.b. Determine Available Sunlight.

The amount of useful sunshine available for the panels on an average day during the worst month of the year is called the “insolation value.” (We use the worst month for analysis to ensure the system will operate year-round.) In most of Texas, average solar insolation values range from about 3.3 to 5.0 hours per day in December, with the lowest values in east Texas and the highest values in the Panhandle and far west Texas (see Figure 1). The insolation value also can be interpreted as the kilowatt-hours per day of sunlight energy that fall on each square meter of solar panels at latitude tilt.

1.c. Determine PV Array Size. For a PV system powering loads that will be used every day, the size of the array is determined by the daily energy requirement (1.a.) divided by the sun-hours per day (1.b.). For systems designed for non-continuous use (such as weekend cabins), multiply the result by the days per week the loads will be active divided by the total number of days in the week. For example, for a weekend cabin, multiply by 2/7. Generally, grid-connected systems are designed to provide from 10 to 60% of the energy needs with the difference being supplied by utility power.

1.d. Determine Battery Bank Size. Most batteries will last longer if they are shallow cycled—discharged only by about 20% of their capacity—rather than being deep-cycled daily. A conservative design will save the deep cycling for occasional duty, and the daily dis-

The average Texas household uses approx. 1,100 kilowatt-hours (kWh) of electricity per month, or about 36,000 Wh of electricity per day. In contrast, a home designed to be energy efficient can use as little as 6,000-10,000 Wh per day. As you might guess, a PV system designed to power an energy efficient home will cost much less.

charge should be about 20% of capacity. This implies that the capacity of the battery bank should be about five times the daily load. It also suggests that your system will be able to provide power continuously for five days without recharging (such as during a winter storm). Multiply the daily load (1.a.) by 5, and then divide the result by the voltage of the battery bank you will use (typically 12 volts). The result is the recommended amp-hour rating of the battery bank. If you wish to be more secure and design for more days of cloudy weather multiply by a number greater than 5. However, it is generally not recommended to design for more than 12 days of cloudy weather unless it is a highly critical load. Of course, you can skip this step entirely if your system does not incorporate a battery bank, such as a water pump, or is grid-connected since the availability of grid power obviates the need for storage.

STEP 2. CALCULATE PV SYSTEM COSTS

2.a. Estimate PV Array Cost. Many PV modules can be purchased at retail for about \$5 per watt for most small systems in the 150 – 8,000 watt range. Of course, there are opportunities to purchase modules for a lower price, especially when your system is larger and you

can buy in bulk. When purchasing modules, look for a UL listing (which certifies that the modules meet electrical safety standards) and long-term warranties. Some manufacturers offer modules with 10-20 year warranties.

2.b. Estimate Battery Bank Cost (if needed). Many flooded lead acid batteries designed for use with PV systems can be purchased at retail for under \$1 per amp-hour.

2.c. Estimate Inverter Cost (if needed). An inverter will be needed for systems that output AC power. For stand-alone

systems the inverter should be sized to provide 125% of the maximum loads you wish to run simultaneously at any one moment. For example, if the total loads you wish to run will be 1,600 watts (a dishwasher, television and ceiling fan from Table 1) choose an inverter with a rated continuous power output of 2,000 watts. For grid-connected systems the maximum continuous input rating of the inverter should be about 10% higher than the PV array size to allow for safe and efficient operation. The input rating of the inverter should never be lower than the PV array rating. For more information contact an

WORKSHEET – ESTIMATING THE COST OF PHOTOVOLTAIC SYSTEMS

Step 1. Determine the load, available sunlight, array size, battery bank size:

- a. Determine the energy load required in watt-hours (Wh) per day. Multiply the number of watts the load will consume by the hours per day the load will operate (see Table 1). Multiply your result by 1.5.
Total Wh per day required: _____ Wh
- b. Determine the hours per day of available sunlight at the site (see Figure 1).
Total available sunlight: _____ hrs/day
- c. Determine the PV array size needed. Divide the energy needed (1.a.) by the number of available sun hours per day (1.b.).
Total array size required: _____ Watts
- d. Determine the size of the battery bank (if one is desired). Multiply the load (1.a.) by 5 (result is watt-hours, Wh). Then divide by the battery voltage (for example, 12 volts) to get the amp-hour (Ah) rating of the battery bank.
Total Battery Bank Required: _____ Ah

Step 2. Calculate the cost of the PV system needed for this application:

- a. Multiply the size of the array (1.c.) by \$5 per watt.
Cost estimate for PV array: \$ _____
- b. If a battery bank is used, multiply the size of the battery bank (1.d.) by \$1 per amp hour.
Cost estimate for battery bank: \$ _____
- c. If an inverter is used, multiply the size of the array (1.c.) by \$1 per rated watt.
Cost estimate for Inverter: \$ _____
Subtotal: \$ _____
- d. Multiply the subtotal above by 0.2 (20%) to cover balance of system costs (wire, fuses, switches, etc.).
Cost Estimate for Balance of System: \$ _____
Total Estimated PV System Cost: \$ _____

inverter supplier. Inverters designed for residences and other small systems can be purchased at retail for about \$1 per rated watt.

2.d. Estimate Balance of System Cost. Besides PV modules and batteries, complete PV systems also use wire, switches, fuses, connectors and other miscellaneous parts. We use a factor of 20% to cover balance of system costs.

COMPARE TO ALTERNATIVES

A final step in an economic feasibility study is to compare estimated costs of the PV system to other alternatives. The most common alternative to off-grid PV is a line extension from an electric utility company. Utilities in Texas typically charge anywhere from \$5,000 to \$30,000 per mile for line extensions, so for many small- or medium-sized loads in remote locations PV systems are the economically feasible choice. For this reason, several rural electric cooperatives in the state now offer their customers PV systems in lieu of more costly line extensions. Line extensions also may be prohibitively expensive even when the distance traveled is short, such as in urban areas where pavement cuts are required.

Other alternatives include on-site diesel generators, hybrid wind-solar systems, or simply making energy improvements such as installing energy-efficient appliances, improving insulation and sealing ducts. Each alternative comes with its own benefits and drawbacks, many of which are difficult to quantify. For example, the cost of purchasing and delivering diesel fuel to a remote generator should be considered in an economic analysis of alternatives, as well as the noise and exhaust generated as byproducts of the energy production.

STICKER SHOCK? THE IMPORTANCE OF EFFICIENCY

If you've just completed the worksheet to estimate the cost of a PV system for your home, chances are the price may seem a bit high. This is why most people who use PV to power their homes design them to be energy efficient. This means they build their homes with excellent insulation, take advantage of energy efficient designs, and pay attention to important factors such as site selection, shading, and orientation. With some careful planning, it is possible to reduce a home's electrical loads by 50 to 80 percent without sacrificing comfort and convenience.

RESOURCES

FREE TEXAS RENEWABLE ENERGY INFORMATION

For more information on how you can put Texas' abundant renewable energy resources to use in your home or business, visit our website at www.InfinitePower.org or call us at 1-800-531-5441 ext 31796. Ask about our free lesson plans and videos available to teachers and home schoolers.

ON THE WORLD WIDE WEB:

Center for Renewable Energy and Sustainable Technology (CREST)
www.solstice.crest.org

NREL'S National Center for Photovoltaics
www.nrel.gov/ncpv

Florida Solar Energy Center
www.fsec.ucf.edu

Department of Energy Solar Site
www.eren.doe.gov/RE/solar.html

Sandia Laboratory photovoltaics with load calculation worksheets
www.sandia.gov/pv



RENEWABLE ENERGY
THE INFINITE POWER
OF TEXAS

STATE ENERGY CONSERVATION OFFICE
111 EAST 17TH STREET, ROOM 1114
AUSTIN, TEXAS 78774
PH. 800.531.5441 ext 31796
www.InfinitePower.org